

## TEST REPORT

REPORT NO.: 2006CB0129

PAGE : 1 OF 2

This Test Report refers only to samples submitted by the applicant to SIRIM QAS International Sdn. Bhd. and tested by SIRIM QAS International Sdn. Bhd. This test report shall not be reproduced, except in full and shall not be used for advertising purposes by any means or forms without written approval from Executive Director, SIRIM QAS International Sdn. Bhd. Please refer overleaf for condition Relating to The Use of Test Report.

Applicant : SUN BLOCK SDN. BHD.  
3 - 2, Level 3, Menara Sunway,  
Jalan Lagoon Timur, Bandar Sunway,  
46150 Petaling Jaya,  
Selangor

Manufacturer : SUN BLOCK SDN. BHD.

Product : Interlocking Concrete Paver

Reference Standard/ Method of test : MS 1380 : 1995  
Specification for Precast Concrete Paving Blocks  
Clause 5 : Compressive Strength


Description of sample : 7 nos of Interlocking Concrete Pavers were received for testing.  
Model : Desert Lily - 60mm  
Serial Number : PL 60 ( 1, 2, 3, 4, 5, 6, 7 )

Date received : 18 / 01 / 2006


Job no./Ref. no. : J20065040045/ ( SQAS/ CBMT/T.REC/CSL/05 )

Issued date : 14 FEB 2006

Approved Signatories

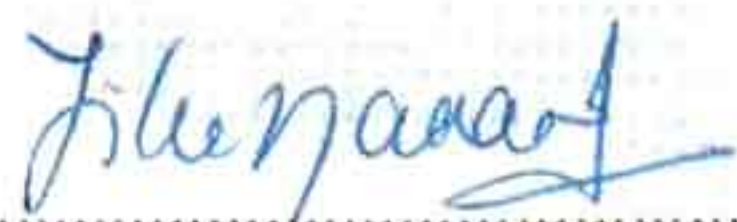

( Y.M. RAJA NOR SIHA BT. RAJA ABD. HANAN )  
Senior Technical Executive



( MOHD. FAUZI ISMAIL )

Senior Manager  
Construction and Building Materials  
Testing Section  
Testing Services Department

# TEST REPORT

REPORT NO.: 2006CB00129

PAGE : 2 OF 2

This Test Report refers only to samples selected by SIRIM QAS International Sdn. Bhd. and tested by SIRIM QAS International Sdn. Bhd. This test report shall not be reproduced, except in full and shall not be used for advertising purposes by any means or forms without written approval from Executive Director, SIRIM QAS International Sdn. Bhd.

## Test Result :

Submittor : **SUN BLOCK SDN. BHD.**  
Sample : **Precast Concrete Paving Block**  
Model : **Desert Lily 60 mm**  
Nominal Thickness : **60 mm**  
Method of Test : **MS 1380 : 1995**  
**Specification for Precast Concrete Paving Blocks**  
**Clause 5 : Compressive Strength**

Sample Reference	Specification/Requirement	Compressive Strength ( N/mm <sup>2</sup> )	Characteristic Compressive Strength ( N/mm <sup>2</sup> )
1	Minimum 28 days Characteristic Compressive Strength shall be a minimum of 45 N/mm <sup>2</sup> .	52.4	51
2		54.9	
3		52.1	
4		53.9	
5		55.0	



14 FEB 2006