

TEST REPORT

REPORT NO.: 2004CB0605

PAGE : 1 OF 2

This Test Report refers only to samples submitted by the applicant to SIRIM QAS International Sdn. Bhd. and tested by SIRIM QAS International Sdn. Bhd. This test report shall not be reproduced, except in full and shall not be used for advertising purposes by any means or forms without written approval from Executive Director, SIRIM QAS International Sdn. Bhd. Please refer overleaf for Conditions Relating To The Use of Test Report.

Applicant : SUN BLOCK SDN. BHD.
 3 - 2 , Level 3 , Menara Sunway ,
 Jalan Lagoon Timur , Bandar Sunway ,
 46150 Petaling Jaya , Selangor.

Manufacturer : SUN BLOCK SDN. BHD.

Product : Compressed Concrete Paving Slab

Reference Standard/
 Method of test : MS 738 ; 1981
 Specification for Terrazzo Floor Tiles
 Clause 15 : Water Absorption


Description of sample : 7 nos of Compressed Concrete Paving Slab were received for testing.
 Nominal Dimension : 400 mm x 400 mm x 40 mm
 Model : Eurotile TO

Date received : 09.03.04


Job no./Ref. no. : 04TSB0907 / (SQAS/CBMT/T.REC/CSL/05)

Issued date : **19 APR 2004**

Approved Signatories

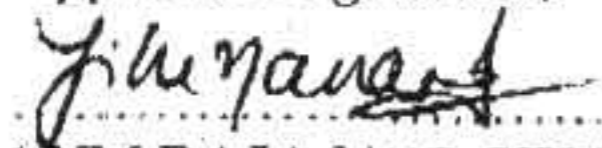
 (Y.M. RAJA NOR SIHA)
 Senior Technical Executive

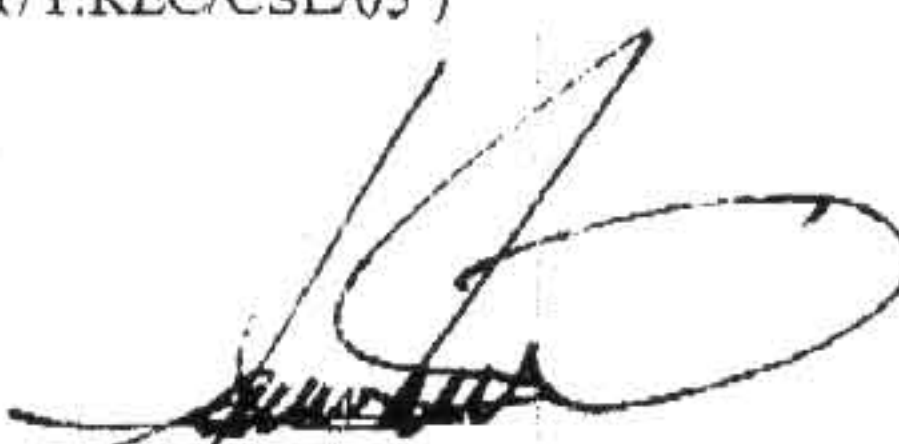


 (MOHD. FAUZI ISMAIL)
 Senior Manager

Construction and Building Materials Testing Section
 Testing Services Department

TEST REPORT

REPORT NO.: 2004CB0605

PAGE : 2 OF 2

This Test Report refers only to samples submitted by the applicant to SIRIM QAS International Sdn. Bhd. and tested by SIRIM QAS International Sdn. Bhd. This test report shall not be reproduced, except in full and shall not be used for advertising purposes by any means or forms without written approval from Executive Director, SIRIM QAS International Sdn. Bhd.

Result :

Submittor : SUN BLOCK SDN. BHD.
Specimen : Compressed Concrete Paving Slab
Nominal Dimension : 400 mm x 400 mm x 40 mm
Brand : Eurotile TO
Ref. Standard : MS 738 : 1981

Clause	Test	Test Result
15	Water Absorption	
	(a) Water Absorption by tile – face	TO – M9 – 815 – POO – 1 = 0.28 g/cm ² TO – M9 – 815 – POO – 2 = 0.35 g/cm ² TO – M9 – 815 – POO – 3 = 0.28 g/cm ² Average : 0.30 g/cm ²
	(b) Total Absorption	TO – M9 – 815 – POO – 4 = 4.6 % TO – M9 – 815 – POO – 5 = 4.3 % TO – M9 – 815 – POO – 6 = 4.2 % TO – M9 – 815 – POO – 7 = 4.6 % Average: 4.4 %

